MOSQUITO ABATEMENT

upporting solutions for basic


sanitation infrastructure


56% of homes

and businesses in unincorporated STP have Onsite Sewage Disposal Systems (OSDS)

Most OSDS - 57% fail inspection

36,303 homes and businesses with OSDS

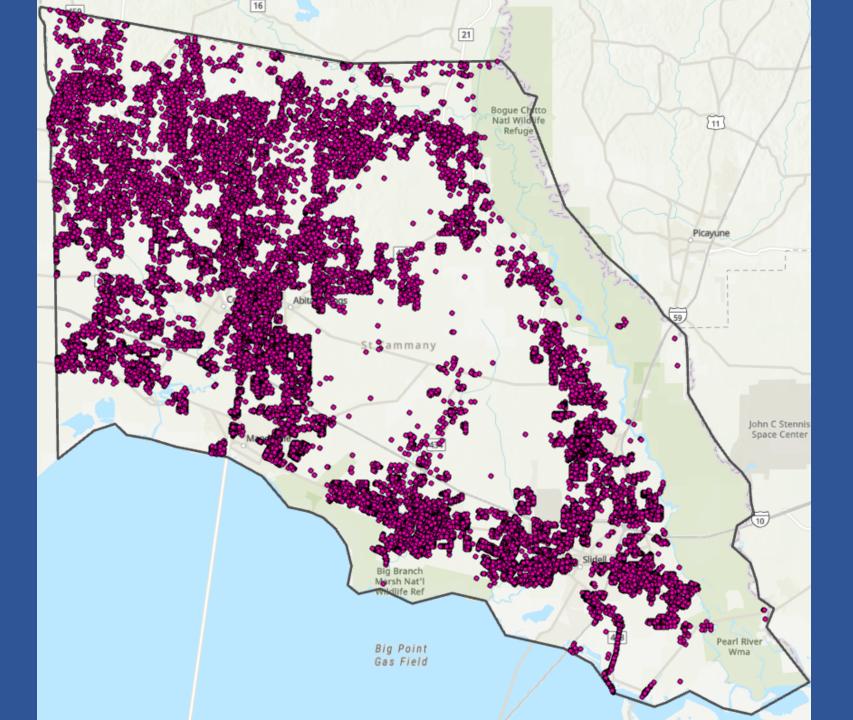

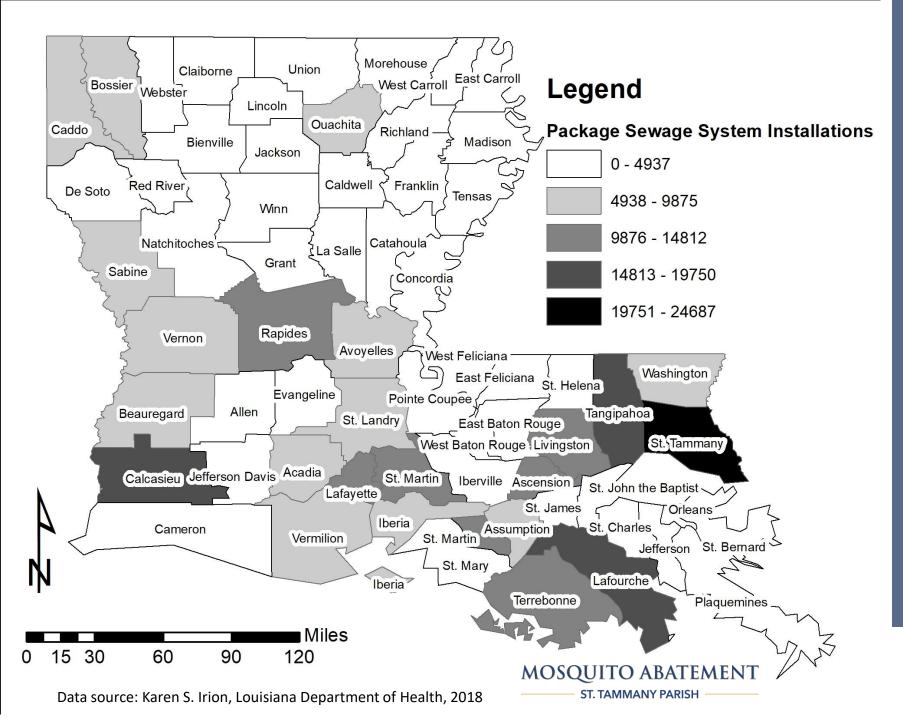

OSDS in **St. Tammany** discharge **17.5 - 30 Million Gallons of** wastewater per day.t

⁺Pontchartrain Conservancy

Exceeds EPA recommended level for safe skin contact by 480-fold

100.000

90,000

80,000

70,000

60,000

50,000

40,000

30,000

20,000

10,000

0

Fecal Coliforms




SWIMMING ADVISORY ISSUED FOR THIS AREA

High levels of bacteria have been detected, and swimming is NOT advised. This advisory will remain in effect until bacteria levels are in compliance.






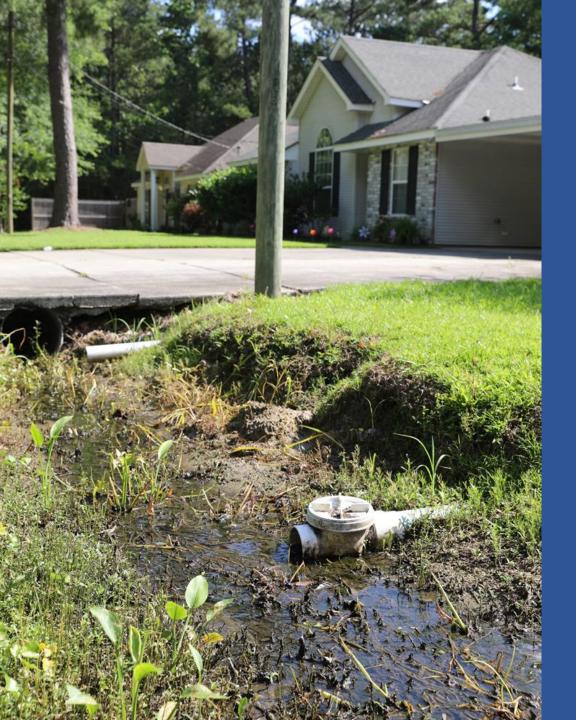

6-fold more **West Nile virus** vectors collected within $\frac{1}{2}$ mile of sewage-influenced ditches



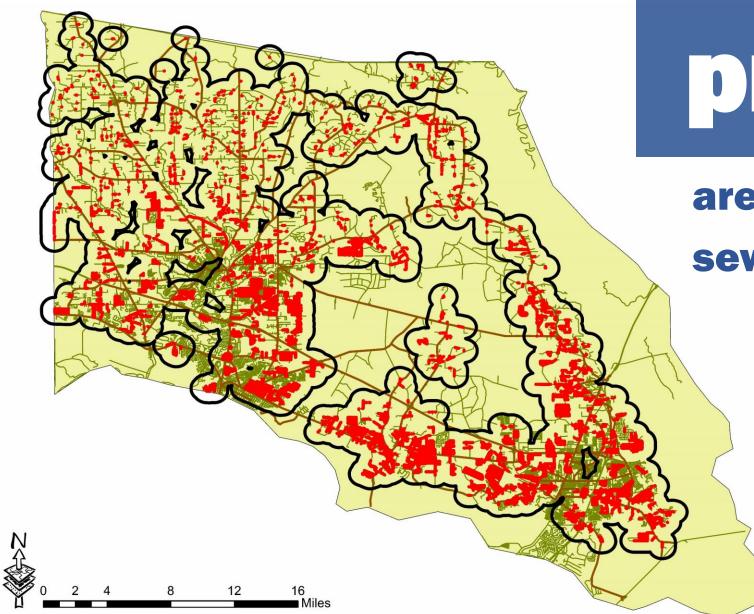



are within ½ mile of sewage-influenced ditches



CENTERS FOR DISEASE CONTROL AND PREVENTION

